


MAIN SERVICE PANEL

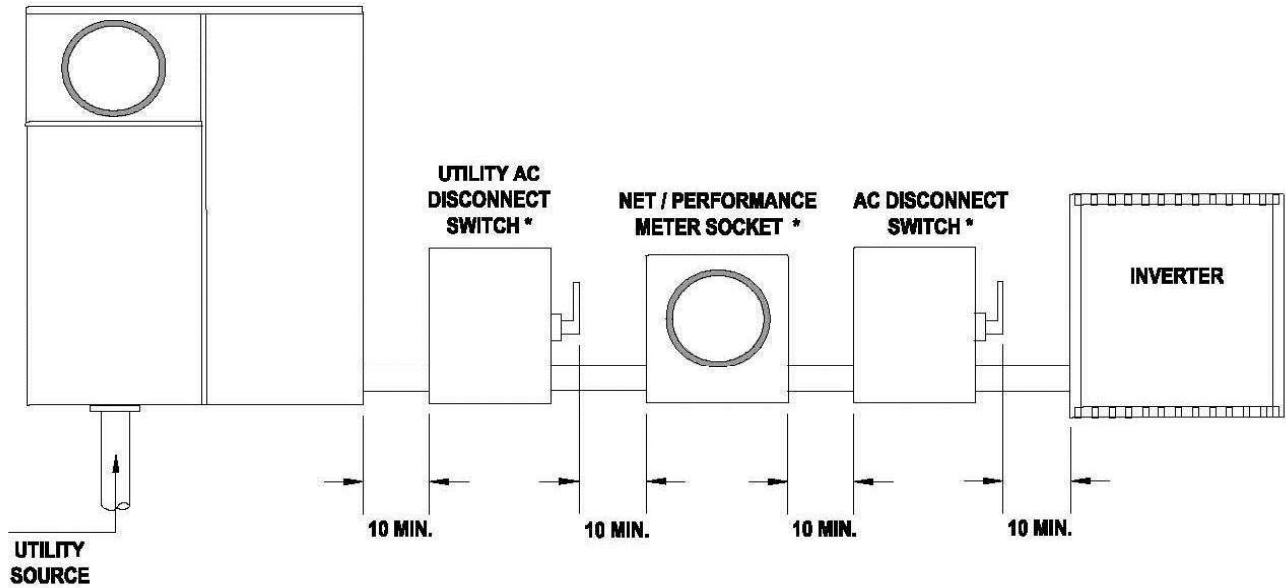

NOTES:

1. * Check the Acceptability Tables for utility requirements.
2. All AC disconnect switches shall be load break rated.
3. A safety socket may be required. Consult your local utility.
4. A minimum 10" clearance is required from the edge of any enclosure.
5. Drawing 300, subsection II.I shall apply up to and including the Net/Performance meter.

ALL DIMENSIONS SHOWN ARE IN INCHES

RE	CHANGE	BY	DSGN	APPV	DATE	REV	CHANGE	BY	DSGN	APPV	DATE
A						D					
B						E					
C						F					

<p>SHEET 1 OF 1</p>	Indicates Latest Revision	<input checked="" type="checkbox"/> Completely Revised	<input type="checkbox"/> New Page	<input type="checkbox"/> Information Removed	<p>SECTION 500 DRAWING 502</p>
	<p>EUSERC MANUAL</p>				
	<p>TYPICAL SERVICE WITH LOAD SIDE INTERCONNECTION</p>				